

# SEWER CONNECTION PERMIT

ISSUE DATE \_\_\_\_\_

ISSUED TO \_\_\_\_\_

ADDRESS \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

FOR \_\_\_\_\_

LOCATION \_\_\_\_\_

Upon condition that the applicant has complied and will comply with Ordinance No. 1172, and the rules and regulations for construction of connecting sewers and without in any way assuming any liability on the part of the Borough by reason thereof, this permit is hereby granted. The Borough must be given 24 hours advance notice before backfilling the entire connection to enable the Borough Manager or Street Commissioner to inspect service line.

Sewer tap must be used in the calendar year in which it is purchased otherwise the tap is void and a new tap must be purchased. Sewer taps are not transferable.

This permit acknowledges receipt of the required tap charge in the amount of \$1,200.00. - *per Tap*

BOROUGH OF CANONSBURG

BY \_\_\_\_\_  
Borough Manager


Inspected By \_\_\_\_\_

Inspection Date \_\_\_\_\_




(Call 745-1800 For Inspection)

THIS IS TO CERTIFY THAT I HAVE READ AND AGREE TO THE ABOVE REQUIREMENT.

\_\_\_\_\_  
Signature and Date

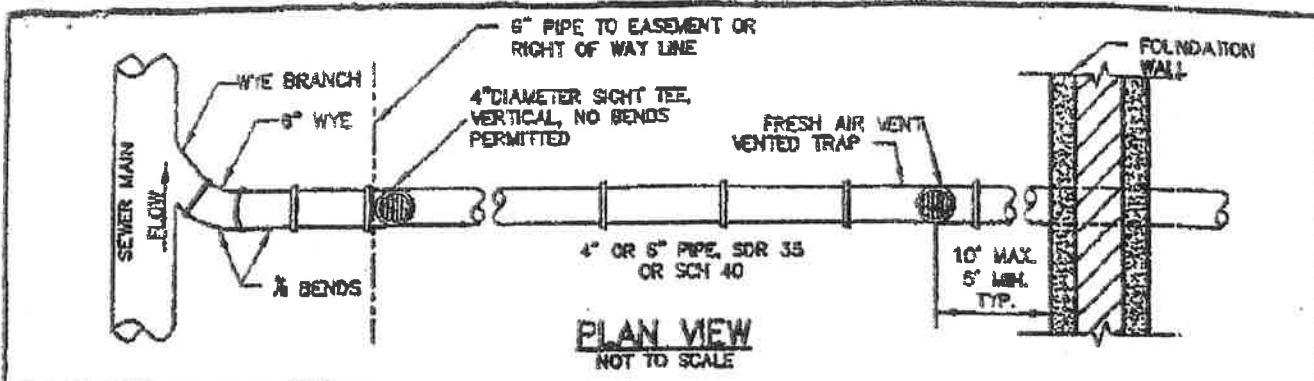

PVC THREADED CAP TO BE USED IN LAWN AREAS AND SHALL BE FLUSH WITH EXISTING SURFACE. IN PAVEMENT AREAS THE SIGHT TEE SHALL BE PROTECTED WITH A NEENAH FOUNDRY R-1978 FRAME AND CASTING SET ON A 4" CONCRETE PAD.

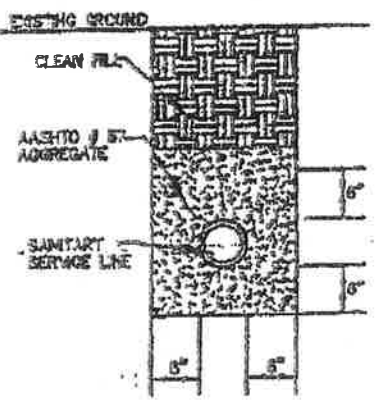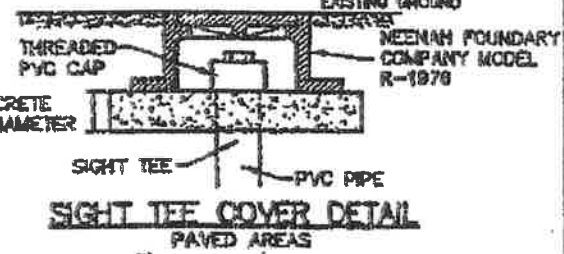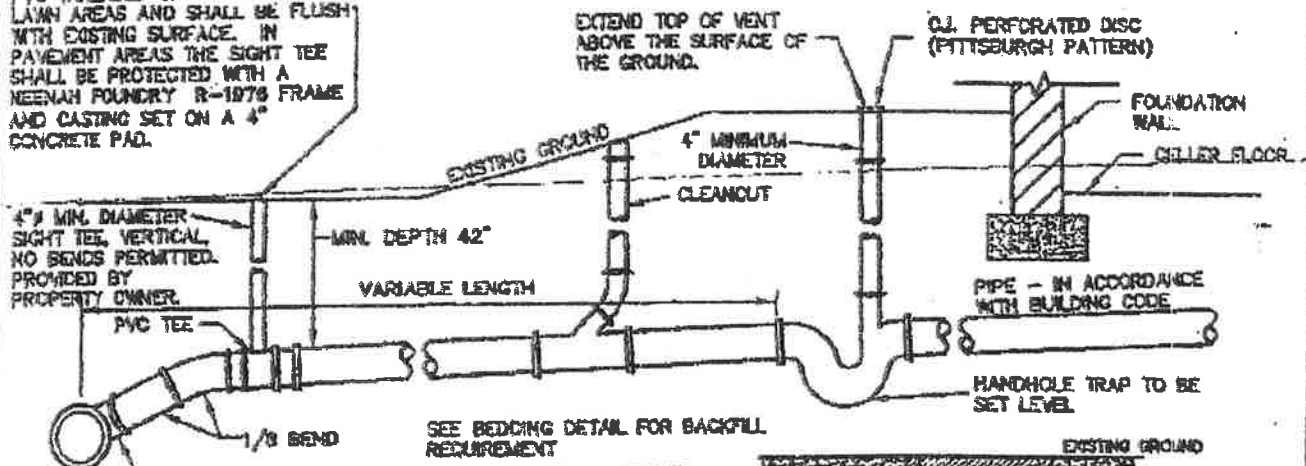

- NOTE:**
- 1.) A TEST TEE MUST BE PROVIDED FOR THE AIR TESTING OF THE LATERAL.
  - 2.) NO ROOF, STORM, CELLAR SEEPAGE, SURFACE WATER OR GROUND WATER OF ANY NATURE SHALL BE ALLOWED TO ENTER THE SEWER SYSTEM. DYE AND/ OR SMOKE TESTING WILL BE PERFORMED BY THE AUTHORITY WHERE REQUIRED.
  - 3.) LATERAL MUST BE INSPECTED AND APPROVED BY THE AUTHORITY & BUILDING INSPECTOR PRIOR TO BACKFILL.
  - 4.) PIPE FITTINGS SHALL MEET THE REQUIREMENTS OF ASTM SPECIFICATIONS D 1785 FOR SCH 40 ASTM D 3084 PVC DR 35.
  - 5.) THE MINIMUM PIPE SLOPE FOR A 4" DIAMETER PIPE SHALL BE 1/4" PER FOOT. FOR SLOPES LESS THAN 1/4" PER FOOT 5" DIAMETER PIPE SHALL BE USED. THE MINIMUM SLOPE FOR 5" DIAMETER PIPE SHALL BE 1/8" PER FOOT.
  - 6.) CLEANOUTS REQUIRED EVERY 100'.
  - 7.) IF FRESH AIR VENT IS WITHIN 4' STRUCTURE, THE FRESH AIR VENT MUST BE LOCATED A MINIMUM OF 10' AWAY FROM ANY FRESH AIR INTAKE TO SAID STRUCTURE.

## STANDARD CONNECTION TO SANITARY SEWER

ADOPTED BY THE BOARD:

Not To Scale

REVISIONS:


## CONSTRUCTION STANDARDS